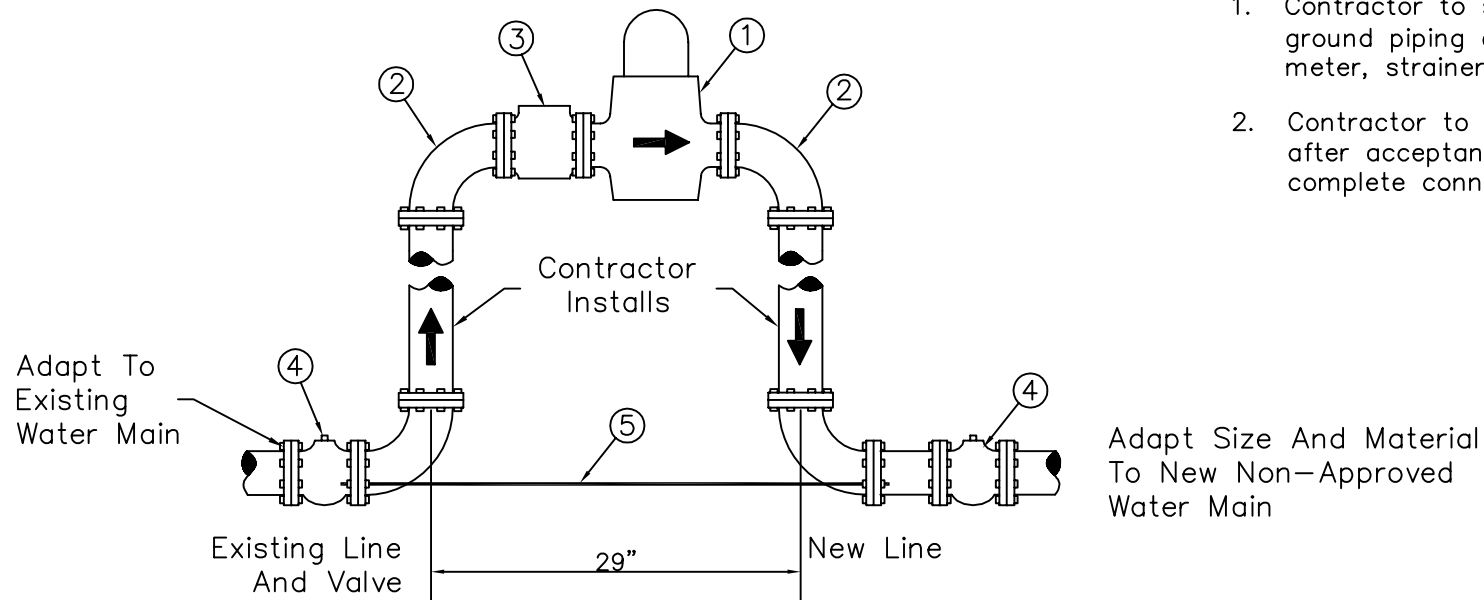


GENERAL NOTES

1. Contractor to supply and install above ground piping and fittings to accommodate meter, strainer and 2 – 90° ells.
2. Contractor to remove piping and fittings after acceptance of new water main and complete connection as per MAG Standards.

LIST OF MATERIALS

- ① 3", 4" & 6" Pressure regulating valve with meter and check feature – supplied by COS.
- ② 3", 4" & 6" Flanged ductile iron 90° ell – supplied by COS.
- ③ 3", 4" & 6" Strainer – supplied by COS.
- ④ Line valves shall be within a 20' maximum distance upstream and downstream of flow meter or as approved by COS, and shall remain in-place after removal of temporary meter.
- ⑤ 3/4"Ø zinc coated threaded rod.

DETAIL NO.
2346

City of Scottsdale
Standard Details

TEMPORARY CONSTRUCTION METER

DETAIL NO.
2346